

easi-joist®



Easi-joist Fire Resistance

This is to certify that Wolf Systems Ltd. easi-joist floor system has been tested according to BS 476 : Part 21 : 1987 and achieved a Fire Resistance Rating of 40 minutes which exceeds Requirement B3 of The Building Regulations


Ref: Report Number 229965

Test Date: 11th July 2006

Testing Body: BRE Testing



Floor Construction

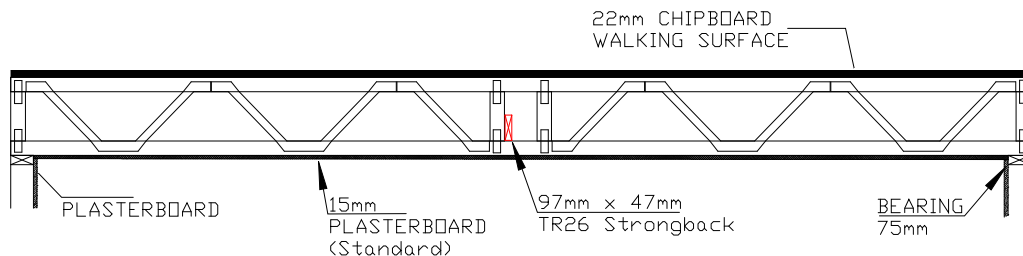

219mm easi-joists at 600mm centres

Ceiling – 15mm Plasterboard fixed at 230mm centres as per manufacturers specification with 38mm Gyproc drywall timber screws.

Decking – 22mm tongue and groove moisture resistant chipboard fixed with appropriate adhesive and screwed down at 200mm centres at the perimeter and 300mm centres on intermediate support using 51mm Gyproc drywall timber screws.



Wolf Systems Limited Shilton Industrial Estate, Shilton, Coventry CV7 9QL

Group manufacturing companies also in: Austria, France, Germany, Hungary, Italy, Poland, Russia, Switzerland.

Directors: D A Leaney BSc (Hons), C D Riches BSc, J Wolf (Swiss), A Ritchie

Consultant: Dr P D Rodd BSc Dphil CEng MICE

Company Registration No 2151148 England

T 0044(0)8707 339933

F 0044(0)8707 339944

Design Office

F 0044(0)8707 339955

E mail@wolfsystem.co.uk

www.wolfsystem.co.uk